

MINANE BRIDGE WATER SUPPLY
GROUNDWATER SOURCE PROTECTION ZONES

Revised 2002

Prepared by:

Denise Kelly & Geoff Wright
Groundwater Vulnerability Mapping by Una Leader
Groundwater Section
Geological Survey of Ireland

Revised May 2002

Table of Contents

1. INTRODUCTION.....	3
2. LOCATION AND SITE DESCRIPTION	3
3. SUMMARY OF WELL DETAILS	3
4. METHODOLOGY.....	3
4.1 DESK STUDY	3
4.2 SITE VISITS AND FIELD WORK	5
4.3 ASSESSMENT.....	5
5. TOPOGRAPHY AND SURFACE HYDROLOGY	5
6. GEOLOGY.....	5
6.1 BEDROCK GEOLOGY.....	5
6.2 SUBSOIL GEOLOGY	6
7. RAINFALL, EVAPOTRANSPIRATION AND RECHARGE.....	6
7.1 RAINFALL	6
7.2 EVAPOTRANSPIRATION	6
7.3 RECHARGE.....	6
8. WATER QUALITY.....	6
8.1 NITRATE	6
8.2 BACTERIA	7
8.3 OTHER PARAMETERS.....	7
9. HYDROGEOLOGY	7
10. GROUNDWATER VULNERABILITY	7
11. CONCEPTUAL MODEL.....	7
12. SOURCE PROTECTION AREAS.....	8
12.1 INTRODUCTION	8
12.2 OUTER SOURCE PROTECTION AREA (SO)	8
12.3 INNER SOURCE PROTECTION AREA (SI).....	9
13. GROUNDWATER SOURCE PROTECTION ZONES.....	9
14. LAND USE AND POTENTIAL POLLUTION SOURCES.....	9
15. CONCLUSIONS AND RECOMMENDATIONS.....	10
16. REFERENCES.....	10

Appendix 1 Water Quality Data

1. Introduction

The objectives of this report are:

- To delineate source protection zones for the Minane Bridge Water Supply Scheme(WSS).
- To outline the principal hydrogeological characteristics of the Minane Bridge area.
- To assist Cork County Council (Southern Division) in protecting the water supply from contamination.

2. Location and site description

The Minane Bridge Water Supply is situated in Springhill townland, approximately 180 m north of the bridge at Minane Bridge in South Cork, and just south of Springhill House. The source was developed in 1977, following some exploratory excavations in June-July 1976. The water source comprises an engineered infiltration gallery, about 40 metres long, which underlies a fairly extensive tract of river gravels and alluvium on the northern side of the stream. The site of the infiltration gallery is fenced off and the pump controls and the sump are protected by a hexagonal pumphouse by the roadside. The water is pumped to a service reservoir in Springhill townland, about 275 m northwest of the source.

Figures 1 and 2 show the site locality in some detail.

3. Summary of well details

GSI no.	1705SW W070
Grid ref. (1:25,000)	17440 05685
Townland	Springhill
Owner	Cork County Council (Southern Division)
Source type	Infiltration Gallery
Elevation (top of casing)	3.17 m O.D.
Depth	~ 9 m (shallow sump)
Dimensions	Sump is c. 2 m diameter. Gallery is c. 40 metres long (E-W). Gallery pipes are 450 mm diameter.
Depth-to-rock	Unknown
Static water level	Unknown but assumed less than 3 m
Drawdown	unknown
Current Abstraction	~ 98 m ³ /d (900 gals/hr) (not continuously)

4. Methodology

4.1 Desk Study

Bedrock geology information was compiled from the published Geological Survey of Ireland 1:100,000 Bedrock Series (Sheet 25), (Sleeman & Pracht, 1994) and subsoil information was compiled from the draft mapping by Teagasc and additional air photo interpretation. Basic source details were obtained from GSI records and County Council personnel.

4.2 Site Visits and Field Work

This included walkover surveys and an investigation into the nature of the alluvial gravel which is being exploited, using trial pitting, to aid in the conceptualisation of the hydrogeology. Vulnerability to contamination and the current pollutant loading in the area were also examined.

4.3 Assessment

This stage utilised field studies and a knowledge of the flow regime in the area to delineate protection zones around the public supply well.

5. Topography and surface hydrology

The unnamed stream which flows eastward beneath Minane Bridge into Ringabella Creek has a catchment area of approximately 26 km² to Minane Bridge. The topography rises quite steeply on both sides of the valley to reach maximum elevations of over 150 metres to the north and over 100 metres to the south. Most of the catchment (c. 75%) lies to the north, where four tributary streams rise; the southern tributaries are much shorter. The south-flowing stream which enters the valley at Ahane Bridge (600 m west of Minane Bridge) is deeply incised into the topography.

The bridge surface is at about 5 metres O.D. The alluvial flat has an elevation of approximately 4 metres above O.D. The O.S. map warns of flooding at spring tides close to the stream. Below the bridge the stream channel is confined by raised banks

6. Geology

6.1 Bedrock geology

6.1.1 Geological succession

The catchment is underlain by rocks of the 'Cork Group', including the Lispatrik Formation, Courtmacsherry Formation (Ringabella Member and Fountainstown Member), Kinsale Formation (Pigs Cove Member, Narrow Cove Member, Cuskinny Member, and Castle Slate Member), the Old Head Formation, and the Gyleen Formation.

Formation	Code	Description
Lispatrik Formation	LP	Pyritic cherty mudstone with dolomite
Courtmacsherry Formation	CY	Calcareous mudstone with limestone
Kinsale Formation	KN	Grey mudstone with subordinate sandstone
Pigs Cove Member	KNpc	Sand-lensed mudstone
Narrow Cove Member	KNnc	Flaser-bedded sandstone & mudstone
Cuskinny Member	KNcu	Flaser-bedded sandstone & mudstone
Castle Slate Member	KNcs	Grey mudstone
Old Head Sandstone Formation	OH	Flaser-bedded sandstone & minor mudstone
Gyleen Formation, Ballyknock Member	GYbn	Green sandstone, siltstone & mudstone

6.1.2 Geological Structure

The rock formations are folded into a small syncline (the Powerhead Syncline), which lies between the Church Bay Anticline (to the north) and another to the south. The axis of the folding is approximately WSW-ENE. The rocks are also broken by a strong system of faults running approximately NNW-SSE, or roughly at right angles to the fold axes. The faulting has generally resulted in moving the rocks to the east of each fault a little way to the south (i.e. they are dextral wrench faults). One such fault crosses the valley, just to the west of the Bridge.

6.2 Subsoil geology

6.2.1 Subsoil types

Two subsoil types were identified in the area: Till and Alluvium.

6.2.1.1 Till

Till, described on the 1902 mapping as ‘stony clay’, occurs over much of the upland areas. Recent draft maps by Teagasc (1999) distinguish between ‘Limestone Till’ (largely derived from Carboniferous limestones) and ‘Sandstone Till’ (largely derived from the sandstones and mudstones of the Cork Group). The sandstone till generally lies north of the valley, and limestone till to the south, plus some small occurrences on the north side, immediately around Minane Bridge itself.

6.2.1.2 Alluvium

The alluvial deposits comprise a thin upper layer, mainly silty clay and peat, about 1-2 metres thick, overlying an alluvial gravel of uncertain depth. Evidence for this comes from notes taken at the time of the original exploration for the infiltration gallery in 1976, the construction of the gallery in 1977, and a trial pit excavated nearby in 1999 for this project.

6.2.2 Depth to bedrock

Mapping by GSI (19th Century) and Teagasc (2000) show a number of rock outcrops: along the incised valley north of Ahane Bridge, and along the road to the east and west of Ahane Bridge. There is also an isolated outcrop in the hillside 400 m east of Springhill House. Areas of less than 3 m subsoil cover are quite extensive, particularly to the north of the valley, along the incised valley and along the hillslopes.

7. Rainfall, Evapotranspiration and Recharge

7.1 Rainfall

Long term average annual rainfall (P) is estimated at 1210 mm (Met Eireann).

7.2 Evapotranspiration

Long term average annual actual evapotranspiration (AE) is estimated at 486 mm (EPA).

7.3 Recharge

Long term average annual potential recharge is (1210 - 486) 724 mm. Actual recharge is arbitrarily taken as about 50% of this, say, 360 mm/yr.

8. Water Quality

8.1 Nitrate

Nitrate levels in water from the Minane Bridge source have been a cause of concern for about ten years. Figure A1.1 (Appendix1) presents the available data since 1991. Nitrate levels have ranged as high as 106 mg/l and have been consistently above 40 mg/l (with one recorded exception) throughout the 1990s, and have commonly exceeded the Maximum Acceptable Concentration (MAC) of 50 mg/l. However, there has been some reduction in average levels since 1994, and the two measurements by GSI/State Laboratory in 1999 were both below 50 mg/l. The reduction in nitrate may be due to action taken on foot of warnings to two local landowners in 1991. Further frequent monitoring of the nitrate levels at this source are needed to confirm this downward trend.

High nitrate values have typically been recorded in winter, which may imply an association with polluted runoff from farmyards or fields. However, even though levels are lower in the summer months, they still average out at about 40-45 mg/l.

8.2 Bacteria

Historical records from Cork County Council appear to show that water from this source has quite good bacteriological quality. However, it is thought that most of these samples were treated and the characteristics of the raw water would not show through. Sampling of this source by the G.S.I. in September 1999 found 3 total coliforms per 100 ml. Samples from October 1993 (3 total per 100 ml) and January 1996 (41 total per 100 ml) also showed bacteriological contamination.

8.3 Other parameters

Potassium/Sodium ratios for this source also seem to indicate some form of organic contamination. The background ratio in most groundwaters is usually less than 0.4. Soiled water and wastes from plant organic matter will have a ratio considerably greater than 0.4. Sampling in April and September noted ratios of 0.83 and 0.67 respectively.

Although this source is quite close to the sea, chloride levels are not in themselves a cause for concern. They are however, slightly elevated at 61.9 mg/l in April 1999 and 55.5 mg/l in September as would be expected for a source close to tidal waters.

Groundwater hardness values from this source are moderately hard at around 220 mg/l CaCO₃.

9. Hydrogeology

The bedrock in the Minane Bridge area (Cork Group – Kinsale, Courtmacsherry and Lispatrick formations) is classified as a **Locally Important Aquifer, moderately permeable only in local zones (L)**.

The aquifer feeding the Infiltration Gallery is the alluvial gravel, which is classified as a **Locally Important Gravel Aquifer (Lg)**. The thickness of the gravel is not known, but by comparison with other local gravel aquifers (e.g. in the Bandon Valley) is unlikely to be much above 10 metres.

Relevant data for the gravel aquifer, such as thickness, permeability, transmissivity, porosity, water levels or gradients, are lacking. In their absence, some values typical of such aquifers (by reference to similar deposits elsewhere in Cork) have been used in the aquifer conceptualisation and estimation of the source protection areas.

10. Groundwater Vulnerability

The gravel aquifer is protected by only a thin layer of alluvial silt clay and peat, which appears to be less than 3 metres thick. Hence, the groundwater vulnerability category around the gallery and on the alluvial flat is 'extreme' (*E*).

Away from the alluvial flat, the vulnerability depends mainly on the subsoil thickness or depth to bedrock. Where this is less than 3 m, the vulnerability is 'extreme'; where it is greater than 3 m, the vulnerability is classed as 'high (possibly moderate in places)'.

The extreme vulnerability areas cover the hill slopes bordering the alluvium, except for a couple of small areas to the northeast and east of Minane Bridge (Map 2).

11. Conceptual Model

The aquifer is an alluvial gravel deposit which is covered by a thin layer (c. 1.2m) of finer grained alluvial material, including peat and silty clay. The aquifer is fed by surface and subsurface water

draining from the surrounding hillsides, by direct recharge of rainfall over the surface of the alluvium, and (possibly) by lateral percolation of water in streams flowing through the alluvium.

Groundwater entering the gallery itself can be envisaged as travelling along three routes:

- Water drawn in from the stream, which lies just over 100 metres south of the gallery. Given the small hydraulic head which the gallery develops, this is probably a negligible source of water to the gallery. This seems to be confirmed by the hydrochemistry of the water.
- Subsurface flow within the gravel aquifer. This is expected to be flowing parallel to the stream, i.e. eastwards. Since the gallery is orientated in the same direction as this groundwater flow (i.e. roughly east-west), it is not well positioned to intercept this flow. Consequently, this source probably provides only a minor proportion of the pumpage from the gallery.
- Subsurface flow from the hillside to the north of the gallery, plus shallow subsurface flow ('interflow') and surface runoff which infiltrates into the ground at the foot of the slope. Since the gallery is orientated at right angles to the direction of this flow, it is optimally placed to intercept it. Hence it is expected that this source contributes most of the flow into the gallery, and therefore also contributes most to the problems of water quality.

The groundwater catchments are assumed to coincide with the relevant surface water catchments.

12. Source Protection Areas

12.1 Introduction

This section describes the delineation of the areas around the gallery that are believed to contribute groundwater to the public water supply at Minane Bridge, and that therefore require protection. The areas are delineated on the basis of the conceptualisation of the groundwater flow pattern, as described above. Given the limited amount of calibration data available, a full groundwater numerical model is not believed to add significant useful information to the conceptualisation.

Two source protection areas are delineated:

- ◆ Inner Protection Area (SI), designed to give protection from microbial pollution;
- ◆ Outer Protection Area (SO), encompassing the remainder of the zone of contribution (ZOC) of the well.

12.2 Outer Source Protection Area (SO)

In theory, stream water could reach the gallery through the gravel aquifer. Hence, the entire stream catchment could be regarded as the Zone of Contribution to the gallery. However, as outlined above (Section 11), infiltration from the stream to the gallery is probably negligible.

The Zone of Contribution to the gallery is therefore envisaged as comprising:

- The alluvial flat extending to the south of the gallery as far as the stream, to the west as far as the Bridge, and to the east as far as the calculated down-gradient 'null point', i.e. 100 metres;
- The surface catchment draining to the gallery and to those parts of the alluvial flat outlined above. This catchment extends northwards and westwards, within the townlands of Minane and Springhill. Its maximum extent is about 600 m to the west and 700 m to the north.

The total extent of this area is approximately 0.2 km² (20 ha) and is shown on the maps.

Another approach is to calculate the area required to supply the current abstraction rate of about 98 m³/day. In practice, GSI normally increases the current abstraction rate by 50% or so, to allow for possible future increases in demand. In this case, a designated abstraction rate of 150 m³/d is assumed.

If annual recharge is about 360 mm (Section 7), then the area required to provide 150 m³/d all year round is 0.15 km², or 15 hectares. This compares reasonably well with the above figure.

12.3 Inner Source Protection Area (SI)

This area was estimated by first calculating the 100-day time-of-travel distance to the gallery, based on the estimated aquifer characteristics, as follows:

- Aquifer permeability (k) 20 m/d
- Hydraulic gradient 0.005
- Aquifer porosity 0.2

Using these parameters, the groundwater velocity is estimated as 0.5 m/d, hence the 100-day time-of-travel distance is 50 metres. Hence the Inner Protection Area extends 50 metres in all directions from the gallery.

However, to the north of the gallery a 50 metre zone extends beyond the alluvial flat and up the hillside. It is clear that shallow subsurface flow (interflow) and surface runoff down the hillside would infiltrate the gravel at the foot of the slope, well within the 50 metre area. Therefore, to provide adequate protection to the gallery, the SI area must be extended up-gradient to include all the surface catchment which can drain directly into the 50-metre area. (Map 3).

13. Groundwater Source Protection Zones

The groundwater protection zones are obtained by integrating the two elements of land surface zoning (source protection areas and vulnerability categories) – a possible total of 8 source protection zones (see the matrix in the table below). In practice, the source protection zones are obtained by superimposing the vulnerability map on the source protection area map. Each zone is represented by a code e.g. **SI/H**, which represents an Inner Protection area where the groundwater is highly vulnerable to contamination. Four groundwater protection zones are delineated around the gallery at Minane Bridge (Map 3), as shown in the matrix below.

Matrix of Source Protection Zones

VULNERABILITY RATING	SOURCE PROTECTION	
	<i>Inner</i>	<i>Outer</i>
<i>Extreme (E)</i>	SI/E	SO/E
<i>High (H)</i>	SI/H	SO/H
<i>Moderate (M)</i>	SI/M (absent)	SO/M (absent)
<i>Low (L)</i>	SI/L (absent)	SO/L (absent)

The response measures imposing restrictions on certain developments and activities within these zones are included in “Groundwater Protection Schemes”, published by DELG, EPA and GSI in 1999. These measures indicate the degree of restriction recommended in each protection zone.

14. Land Use and Potential Pollution Sources

There are some domestic dwellings within the ZOC of the source. A farm with pasture and cattle lies north of the source and directly up-gradient of the gallery, within its Zone of Contribution.

Water quality at the Minane Bridge source is poor although there is a lack of full analyses. Nitrate levels (discussed in Section 8) are unacceptably high and have often exceeded MAC levels.

No detailed assessment of hazards was carried out as part of this study.

The main hazard within the Zone of Contribution is considered to be pollution from farmyards.

15. Conclusions and Recommendations

- ◆ The public water supply at Minane Bridge consists of an engineered infiltration gallery, about 40 metres long, which underlies a fairly extensive tract of river gravels and alluvium on the northern side of the stream. It is located in Springhill townland just north of the village.
- ◆ The bedrock in this area is the Courtmacherry Formation and is classified as a Locally Important Aquifer, moderately permeable only in local zones (L1). However the aquifer that the infiltration gallery is abstracting from is the overlying alluvial gravels, which are classified as a Locally Important Gravel Aquifer (Lg). The thickness of the gravel is not known, but trial pitting in 1999 and the reported depth of the gallery itself, suggest that it could be between 5 and 10 m thick (Kelly & Wright, 2000). The groundwater in a large proportion of the catchment for this infiltration gallery is either extremely or highly vulnerable to pollution.
- ◆ Water quality from the gallery is unsatisfactory in a number of respects. The main concern is the nitrate concentration, but other parameters have breached the MAC from time to time, namely *E. coli*, nitrite, and manganese.
- ◆ The inner and outer protection zones delineated in the report are based on our current understanding of groundwater conditions and on the available data. Additional data obtained in the future may indicate that amendments to the boundaries are necessary.
- ◆ A new gallery further away from the hillside, and orientated to maximise interception of the throughflow in the alluvial gravel aquifer, would probably produce water of better quality.
- ◆ It is recommended that:

Chemical and bacteriological analyses of raw water should be carried out on a regular basis (every 6 months). A treatment system should be installed for the village supply. The chemical analyses should include all major ions - calcium magnesium sodium, potassium, ammonium, bicarbonate, sulphate, chloride, and especially nitrate.

Particular care should be taken in allowing any activities or developments which might significantly increase nitrate levels or cause further contamination in the gallery.

The potential hazards in the ZOC should be located and assessed.

Interim guidelines should be drawn up for dealing with underground petroleum storage/transfer, and spillages along the roads in the area.

16. References

- British Standards Institution (1981) *Code of Practice for Site Investigations*. BS 5930:1981. British Standards Institution, London, 147 p.
- Daly, D. & Swartz, M. (1999) *Notes for Groundwater Section Staff: Using BS 5930 to describe subsoils*. Geological Survey of Ireland.
- DELG/EPA/GSI (1999) *Groundwater Protection Schemes*. Department of the Environment and Local Government, Environmental Protection Agency and Geological Survey of Ireland, 24 pp.
- Kelly, D. & Wright, G.R. (2000) *South Cork Groundwater Protection Scheme*. Groundwater Section, Geological Survey of Ireland.
- Lee, M. (1999) *Surface Hydrology and Vegetation as Secondary Indicators of Groundwater Recharge and Vulnerability*. Unpublished MSc. (research) thesis, Department of Civil, Structural & Environmental Engineering, Trinity College, Dublin
- Sleeman, A.G. & Pracht, M. (1994) *Bedrock Geology 1:100,000 Map Series, Sheet 25, South Cork*, Geological Survey of Ireland.
- Swartz, M. (1999) *Assessing the Permeability of Irish Subsoils*. Unpublished MSc. (research) thesis, Department of Civil, Structural & Environmental Engineering, Trinity College, Dublin

Teagasc/Coillte Forest Inventory and Planning System (FIPS) project (2000) Soils mapping.

Wright, G.R. (2000) *QSC Graphs - An aid to aquifer classification in data-poor aquifers in Ireland*. In Robins, N. S. & Misstear, B.D.R. (eds) *Groundwater in the Celtic Regions: Studies in Hard Rock and Quaternary Hydrogeology*. Geological Society of London, Special Publication 182, 169-177.

Appendix 1
Water Quality Data

Water Quality Data, Minane Bridge WSS
(Data from Inniscarra Laboratory)


		Greater than Guide levels																	Greater than MAC levels								
Units	MAC	Date	Ca	Mg	Na	K	HCO ₃	CO ₃	SO ₄	Cl	TDS	Alk.	TH	Fe	Mn	Nitrite	Nitrate	NH ₄	AI	E. coli	TC	pH	Temp		Lab	EC	
			mg/l	mg/l	mg/l	mg/l	mg/l	mg/l	mg/l	mg/l	mg/l	mg/l	mg/l	mg/l	mg/l	mg/l	mg/l	mg/l	mg/l	mg/l	mg/l		no/100ml	no/100ml			Lab
		15/01/1991	200	50	150	12			250	250				0.2	0.05	0.1	50	0.23	0.2	0	0		6.6	6	1500	1	1
		26/08/1991														0.003	87.71	0.032					6.5	16	680		
		30/09/1991														0.043	44.01	0.014							490		
		13/01/1992																							596		
		27/01/1992														0.004	106.2	0.028					6.6	8	516		
		03/02/1992														0.003	51.09	0.029					6.5	9.5	551		
		18/02/1992																			1			17.5	675		
		06/04/1992																						10	662		
		27/04/1992																						12	660		
		11/05/1992																							783		
		11/06/1992																							741		
		06/07/1992														0	25.76	0.013	0				6.6	19.5	726		
		07/09/1992																						16	539		
		28/09/1992																							631		
		05/10/1992														0.001	52.62	0.015							855		
		11/11/1992														0	57.89	0.013					6.7	11	604		
		16/11/1992																					6.5	9	623		
		30/11/1992																						10	634		
		19/01/1993																							757		
		08/02/1993																							626		
		15/02/1993															82.52								581		
		18/02/1993														0.512	74.56										
		22/02/1993																									
		08/03/1993																									
		15/03/1993																									
		23/03/1993																									
		29/03/1993																									
		05/04/1993																									
		13/04/1993																									
		19/04/1993																									
		22/04/1993																									

Water Quality Data, Minane Bridge WSS
(Data from Innicarra Laboratory)

		Greater than Guide levels																Greater than MAC levels										
Date	Units	Ca	Mg	Na	K	HCO ₃	CO ₃	SO ₄	Cl	TDS	Alk.	TH	Fe	Mn	Nitrite	Nitrate	NH ₄	AI	Bacteria			pH		Temp		EC		
		mg/l	mg/l	mg/l	mg/l	mg/l	mg/l	mg/l	mg/l	mg/l	mg/l CaCO ₃	mg/l	mg/l	mg/l	mg/l	NO ₂	NO ₃	mg/l	mg/l	E. coli	TC	no/100ml	Lab	Lab	Lab	Lab	Lab	Lab
	MAC	200	50	150	12	250	250	250	250			0.2	0.05	0.1	50	50	0.23	0.2	0	0	0							
03/05/1993																				0	0	0						
10/05/1993																				0	0	0			10		638	
02/06/1993																				0	0	0					634	
14/06/1993															0.033	56.44	0.02			0	0	0	6.5	11		709		
26/06/1993															0.007	73.93	0.01			0	0	0	6.3	11		622		
28/06/1993																				0	0	0				625		
05/07/1993																				0	0	0				567		
12/07/1993																				0	0	0		17				
20/07/1993																				0	0	0		17.5		699		
26/07/1993																				0	0	0				596		
03/08/1993																				0	0	0				579		
17/08/1993																		61.39		0	0	0				545		
24/08/1993																				0	0	0		17		544		
31/08/1993																				0	0	0		17		524		
06/09/1993																				0	0	0				183		
13/09/1993																				0	0	0						
20/09/1993																				0	0	0				610		
05/10/1993																				0	0	3				768		
04/11/1993																				0	0	0		11.5		569		
29/11/1993																				0	0	0				600		
10/01/1994																				0	0	0				612		
24/01/1994																				0	0	0				654		
01/02/1994										90	174	0.19	0.08	0.02	73.73	0.067				0	0	0	6.5	8.5		713		
07/03/1994																				0	0	0				494		
29/03/1994																				0	0	0				610		
16/05/1994																				0	0	0				539		
07/06/1994																				0	0	0				547		
21/07/1994																				0	0	0				617		
26/09/1994																				0	0	0				594		
10/10/1994																				0	0	0				470		
25/10/1994																				0	0	0				495		

Water Quality Data, Minane Bridge WSS
(Data from Inniscarra Laboratory)


Greater than Guide levels		Greater than MAC levels																											
Units	Date	Ca	Mg	Na	K	HCO ₃	CO ₃	SO ₄	Cl	TDS	Alk.	TH	Fe	Mn	Nitrite	Nitrate	NH ₄	Al	Bacteria			pH		Temp		EC			
		mg/l	mg/l	mg/l	mg/l	mg/l	mg/l	mg/l	mg/l	mg/l	mg/l	mg/l CaCO ₃	mg/l	mg/l	mg/l	NO ₂	NO ₃	mg/l	mg/l	E. coli	TC	Lab	Lab	°C	Lab	Lab	uS/cm	Lab	Zh
MAC		200	50	150	12			250	250				0.2	0.05	0.1	50	0.23	0.2		0	0					1500	1	1	
	05/12/1994																			0	0					490			
	09/01/1995																			0	0					490			
	13/02/1995																			0	0					408			
	20/02/1995																		0.03	0	0					413			
	07/03/1995							24	55		57	161	0.1	0.025	0.006	53.29	0.01	0.03		0	0	6.5	6.5	6.5	408			0.05	
	19/04/1995																			0	0					435			
	24/04/1995																		0.03	0	0					432		0.5	
	22/05/1995														0.007	47.43	0.01	0.03		0	0	6.4	12			411			
	24/07/1995																			0	0					392			
	19/09/1995																			0	0					444			
	03/01/1996																			0	0					444			
	01/02/1996																			0	0					444			
	05/02/1996												0	0	0.01	58.58	0.01			0	0	6.4	7			524			
	25/03/1996																			0	0					526			
	09/04/1996																			0	0					470			
	25/06/1996														0.016	43	0.013			0	0	6.3	17.5			409			
	07/10/1996																			0	0					433			
	05/11/1996																			0	0					441			
	14/01/1997															56				0	0					495			
	29/01/1997																			0	0					469			
	11/02/1997														0.016	42.44	0.013			0	0	6.7	8.5			498			
	19/02/1997															58				0	0					465			
	19/03/1997															70				0	0								
	08/04/1997															51				0	0								
	11/06/1997															41				0	0								
	17/11/1997															51				0	0								
	10/12/1997															57				0	0								
	07/01/1998															45				0	0								
	17/02/1998															56				0	0								
	24/03/1998															55				0	0								

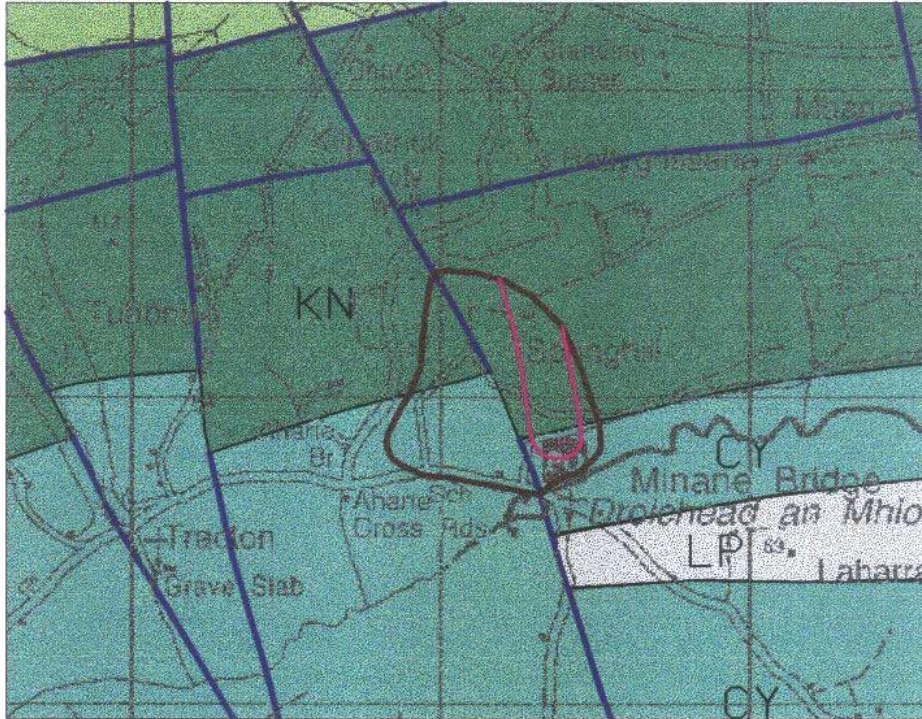

Minane Bridge Water Supply Scheme


0 500m 1 km

Map 1. Geology


-  Old Head Sandstone Formation
-  Courtmacsherry Formation
-  Kinsale Formation

This Bedrock Map is designed for general information and strategic planning usage. The boundaries are based on the available evidence and local details have been generalised to fit the map scale. Evaluation of specific sites and circumstances will normally require further and more detailed assessments, and will frequently require site investigations.

The topographic base is reproduced with the permission of the Ordnance Survey of Ireland







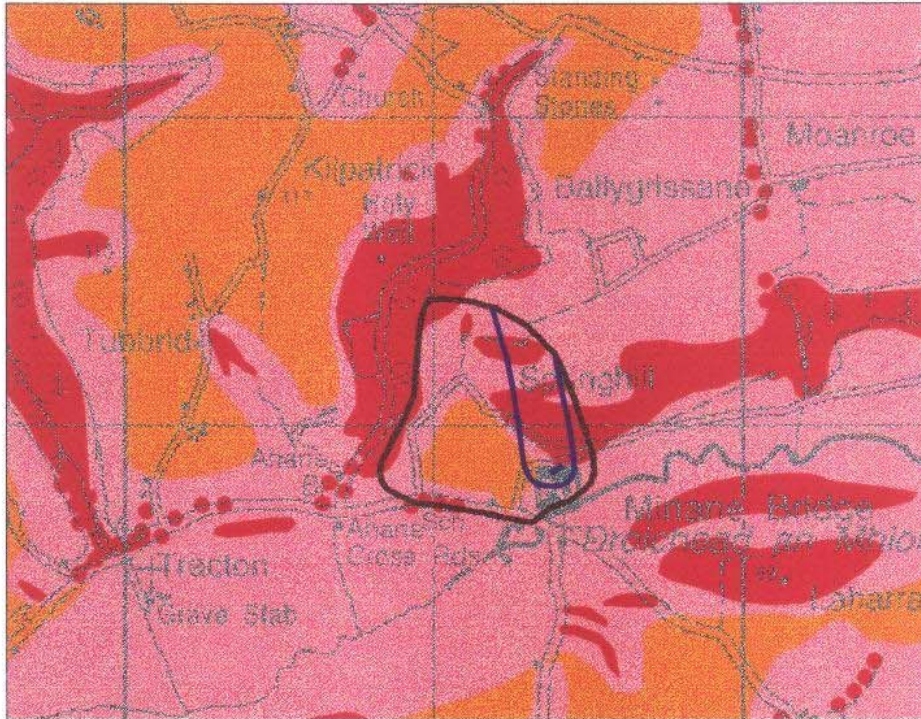

-  Fault
-  Infiltration Gallery
-  Inner Protection Zone

-  Zone of Contribution



Minane Bridge Water Supply Scheme

Map 2. Groundwater Vulnerability


-  Extreme (E)
-  Outcrop/Shallow rock (E)
-  High (H)
-  Moderate (M)
-  Low (L)
-  Infiltration Gallery
-  Zone of Contribution
-  Inner Protection Zone

Vulnerability is a term used to represent the intrinsic geological and hydrogeological characteristics that determine the ease with which groundwater may be contaminated by human activities.

The map shows the vulnerability of the first groundwater encountered (in either sand/gravel aquifers or in bedrock) to contaminants released at depths of 1-2 m below the ground surface. Where contaminants are released at significantly different depths, there will be a need to determine groundwater vulnerability using site-specific data. The characteristics of individual contaminants have not been taken into account.

This vulnerability map is designed for general information and strategic planning usage. The boundaries are based on the available evidence and local details have been generalised to fit the map scale. Evaluation of specific sites and circumstances will normally require further and more detailed assessments, and will frequently require site investigations to determine the risk to groundwater.

The topographic base is reproduced with the permission of the Ordnance Survey of Ireland

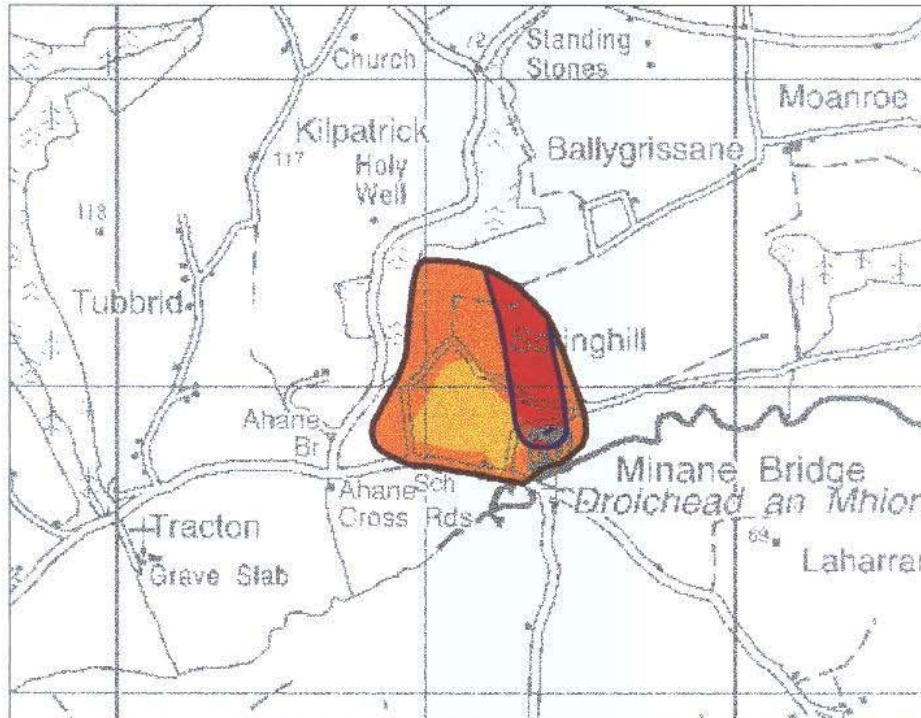

Minane Bridge Water Supply Scheme

Map 3. Source Protection Zones

VULNERABILITY RATING	SOURCE PROTECTION ZONES	
	Inner (SI)	Outer (SO)
Extreme (E)	S/E	SO/E
High (H)	S/H	SO/H
Moderate (M)	S/M	SO/M
Low (L)	S/L	SO/L



Infiltration Gallery



Inner Protection Zone



Zone of Contribution

This **Source Protection Map** is designed for general information and strategic planning usage. The boundaries are based on the available evidence and local details have been generalised to fit the map scale.

Evaluation of specific sites and circumstances will normally require further and more detailed assessments, and will frequently require site investigations.

The map is intended for use in conjunction with groundwater protection responses for potentially polluting activities, which lists the degree of acceptability of these activities in each zone and describes the control measures necessary to prevent pollution.

The topographic base is reproduced with the permission of the Ordnance Survey of Ireland